

Draft Print

05/13/2021 7:44:09 PM

APPENDIX E | ADA SELF-EVALUATION

TABLE OF CONTENTS

Section 1	Bailey-Prouty Playground
.....	89 Prouty Lane
1.A Pressbox	
▪ Site determined to be private storage ONLY, not evaluated	
Section 2	Beaver Brook Park
.....	300 Chandler Street
2.A Community Bld. Restrooms	
2.B Storage Bld	
▪ No access– not evaluated	
2.C Precast Bathroom Bld	
▪ No access – not evaluated	
2.D Little League Concessions Bld.	
▪ No access – not evaluated	
Section 3	Bell Hill (Chandler) Park
.....	184 Belmont Street
3.A Bathroom Bld	
Section 4	Coes Beach
.....	72 Coes Street
4.A Bathroom & Lifeguard Bld.	
Section 5	Crompton Park
.....	47 Quinsigamond Avenue
5.A Pool House Bathrooms	
5.B Park Restrooms	
5.C Green Island Neighborhood Center	
Section 6	Elm Park
.....	121 Russell Street
6.A Bathroom /Maintenance Bld.	
6.B Skate Bld.	
▪ No access – not evaluated	
Section 7	Farber Field
.....	90 Camelot Drive
7.A Bathroom/Concession Bld	
Section 8	Green Hill Park
.....	301 Green Hill Parkway
8.A Park Office/Maintenance Facility (only parks side)	
8.B Green Hill Sports Complex-Bathrooms & Storage	
▪ No access – not evaluated	
8.C Green Hill Greenhouse	
8.D Green Hill Connie Mack Concession Bld.	
8.E Golf Course Clubhouse	

- 8.F Golf Course Snack Shack
- 8.G Green Hill Farm Storage Bldg.
 - Building determined to be not publicly accessed – not evaluated
- 8.H Green Hill Farm Barn House(includes bathrooms/office)
 - Office was not accessible
- 8.I Green Hill Farm Bathrooms (lower level)
- 8.J Green Hill Farm Info/Ticket Bldg.(upper level above bathrooms)
 - No access – not evaluated
- 8.K WVM Farm Cold Storage Bldg.
 - No access – Not evaluated
- 8.L WVM Concession Bldg.
 - No access – Not evaluated

Section 9.....Greenwood Park
.....14 Forsberg Street

- 9.A Spray Park Bath House
- 9.B Historic Bath House
 - Building determined to be abandoned – not Evaluated
- 9.C Caretaker's Bldg.
 - Building determined to be abandoned – not evaluated

Section 10. Hadwen Park
..... 19 Heard Street

- 10.A Bathroom/Concession Bldg.
 - No access, not public – Not evaluated

Section 11. Harry Sherry Field
..... 380 Cambridge Street

- 11.A Neighborhood Center
- 11.B Little League Concession Building

Section 12. Hope Cemetery
.....

- 12.A Administrative Building

Section 13. Indian Lake Beach
.....34 Sherburne Avenue

- 13.A Beach Bathrooms

Section 14. Institute Park
.....82 Salisbury Street

- 14.A Precast Bathroom
- 14.B Bandshell

Section 15. Lake Park
.....600 Hamilton Street

- 15.A Bathroom Bldg
- 15.B Keepers Bldg

Section 16.....	Logan Field
.....	539 Mill Street
16.A Bathroom/Concession Bldg.	
Section 17.....	Mulcahy Field
.....	158 Dorchester Street
17.A Toilet & Concession Bldg	
Section 18.	Newton Square
.....	121 Russell Street
Section 19.....	Rockwood Field
.....	540 Chandler Street
19.A Jesse Burkett Little League Concessions/ Pressbox	
19.B Little League Storage Bldg	
19.C Raymond Field /Softball Concession Bldg.	
▪ Pressbox	
19.D Raymond Field /Softball Bathrooms	
▪ No access – Not evaluated	
19.E Lyon Field Baseball Pressbox	
Section 20.....	Shore Park
.....	85 Shore Drive
20.A Restrooms & Lifeguard	
Section 21.....	Stearn Tavern at Coes Park
.....	
21.A Stearn Tavern Bldg. & Exterior Restrooms	
Section 22.....	Ty Cobb Park
.....	67 James Street
22.A Concession/Bathroom/Pressbox	
Section 23.....	Vernon Hill Park
.....	144 Providence Street
23.A Little League Concession Bldg.	
▪ No access to concessions – only bathrooms evaluated	
23.B Softball Concessions/Bathroom	
23.C Baseball Concession/Bathroom Bldg	
▪ No access to concessions – only bathrooms evaluated	

DISTRICT: 5
LOCATION: BEAVER BROOK PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			2'10" DOOR
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			THRESHOLD IS INCOMPLETE/CRUMBLING
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			THERE IS NO 5' DIAMETER CLEAR SPACE
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			3'-1" CLEAR SINK STALL WIDTH
Mounted without pedestal or legs, height 34" to top of rim			2'-9"
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			3'-1" clear sink stall width
Cover exposed pipes with insulation			

DISTRICT: 5
LOCATION: BEAVER BROOK PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Faucets operable with closed fist (level or spring activated handle)			ONE LEVER - SIDE TO SIDE HEAT ADJUSTMENT
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			STALL EXISTS - ALTHOUGH TABLES ARE CURRENTLY BEING STORED IN THIS STALL
Stall door is 36" wide			STALL BEING USED AS STORAGE AREA
Stall door swings out			STALL BEING USED AS STORAGE AREA
Stall door is self closing			STALL BEING USED AS STORAGE AREA
Stall door has a pull latch			STALL BEING USED AS STORAGE AREA
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			1'-5"
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			2'-9"
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			NO SOAP DISPENSER, 3'-6" PAPER TOWEL DISPENSER
Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			



DISTRICT: 5

LOCATION: BEAVER BROOK PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

BEAVER BROOK PARK
Bathroom Building

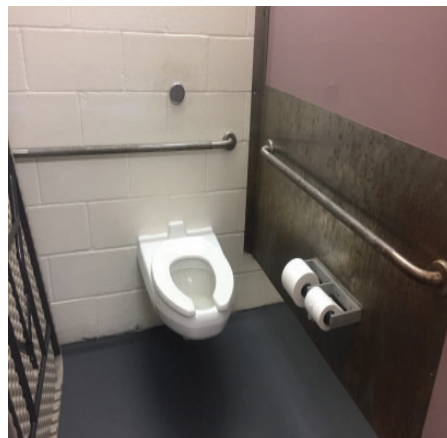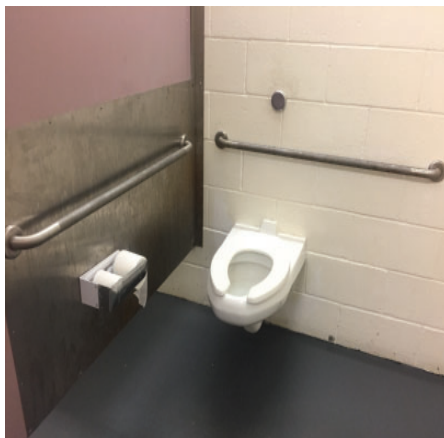

DISTRICT: 1
LOCATION: BELL HILL PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			OUTDATED HARDWARE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO ALARM SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			NO DOOR CLOSER
Maximum pressure 5 pounds interior doors			N/A
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			OUTDATED HARDWARE
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			

DISTRICT: 1
LOCATION: BELL HILL PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			SINGLE KNOB FAUCET
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			2'10" Clear space between toilet and door frame in women's ADA stall
Stall door is 36" wide			2'-10" BOTH RESTROOM STALL DOORS
Stall door swings out			
Stall door is self closing			NO CLOSER
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			SMALL HARDWARE - 40" TO CENTER
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			1'-5"
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			1'-5"
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			RUSTED OUT FIXTURE - > 24"
One mirror set a maximum 38" to bottom (if tilted 42")			NONE
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			LUSH WALL MOUNTED > 1' ABOVE T.O. SINKS
			NO ADA URINAL

Floors, drinking fountains, telephones


Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 1
LOCATION: BELL HILL PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

BELL HILL PARK
Bathroom Building

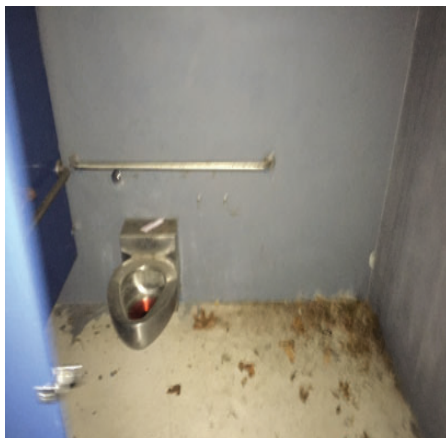

DISTRICT: 5
LOCATION: COES POND BEACH

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			30" BATHROOM DOORS
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			

DISTRICT: 5
LOCATION: COES POND BEACH

BUILDING: RESTROOMS

	Yes	No	Comments
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			BUTTON CONTROLS
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			NO ADA STALL IN WOMEN'S AND MEN'S - ONE ADA ROOM
Stall door is 36" wide			
Stall door swings out			SWINGS IN
Stall door is self closing			NO CLOSER
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			FINGER LOCK LATCH
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			32"
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			40" TO B.O. HAND DRYER
			1'-7" URINAL
Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			WOMEN'S ROOM CLEAR 2'-10"
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Specification			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			

DISTRICT: 5

LOCATION: COES POND BEACH

BUILDING: RESTROOMS

	Yes	No	Comments
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			ADA BATHROOM SIGN NONCOMPLIANT
Within 18" of door jamb or recessed			ADA BATHROOM SIGN NONCOMPLIANT
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			ADA BATHROOM SIGN NONCOMPLIANT
Letters and numbers contrast with the background color			
			ALL SIGNS ARE INCORRECT
			MEN'S AND WOMEN'S ROOM INDICATE WHEEL CHAIR ACCESSIBLE - THESE ARE NONCOMPLIANT WITH 2'-10" AND 3'-6" CLEAR CIRCULATION BETWEEN PARTITIONS AND WALLS
			ACCESSIBLE BATHROOM SIGN OUTDATED

COES BEACH
Bathroom & Lifeguard
Building



DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: POOL HOUSE

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			4'-6" HALL
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			FLAT PULL HANDLE STYLE HARDWARE WITH >1.5" CLEARANCE BETWEEN PULL SURFACE AND DOOR SURFACE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			
Door mats less than 1/2" thick are securely fastened			
Door mats more than 1/2" thick are recessed			
Grates in path of travel have openings of 1/2" maximum			
Signs at non-accessible entrance(S) indicate direction to accessible entrance			
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A
Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
SECTION 5			
Extends at least 22" from the wall			

DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: POOL HOUSE

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			BUTTONS
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			WOMEN'S - CL TO WALL = 1'-4", MEN'S = 1'-5"
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			MISSING FIXTURES
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			MISSING FIXTURES
			URINALS AT 1'-4" AND 2'-10" HIGH

Floors, drinking fountains, telephones			
floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
SECTION 5			

DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: POOL HOUSE

	Yes	No	Comments
Telephones			
<i>Specification</i>			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

Swimming pools - accessibility can be via ramp, lifting device, or transfer area			
Ramp at least 34" wide with a non-slip surface extending into the shallow end, slope not exceeding 1:6 with handrails on both sides			
lifting device			
Transfer area 18" above the path of travel and a minimum of 18" wide			
Unobstructed path of travel not less than 48" wide around pool			
Non-slip surface			

Showers rooms - showers must accommodate both wheel-in and transfer use			
Stalls 36" by 60" minimum, with 36" door opening			NO STALL
Floors are pitched to drain the stall at the corner farthest from entrance			NO EFFECTIVE PITCH
Floors are non-slip surface			
Controls operate by a single lever with a pressure balance mixing valve			
Controls are located on the center wall adjacent to the hinged seat			
Shower head attached to a flexible metal hose			
Shower heads attached to wall mounting adjustable from 42" to 72" above the floor			NOT ADJUSTABLE
Seat is hinged and padded and at least 16" deep, folds upward, securely attached to side wall, height is 18" to top of the seat, and at least 24" long			NO SEAT
Soap trays without handhold features unless they can support 250 pounds			MISSING FIXTURES
2 grab bars are provided, one 30" and one 48" long or one continuous L shaped bar			BARS ADJACENT TO SHOWER AREA INSTEAD OF AROUND
Grab bars are placed horizontally at 36" above the floor line			NO BARS IN COMPLIANT LOCATION

SECTION 5

DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			
Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A
Restrooms			
<i>Specification</i>			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			

SECTION 5

DISTRICT: 4

LOCATION: CROMPTON PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			RESIDENTIAL TOILET STYLE
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A

SECTION 5

DISTRICT: 4

LOCATION: CROMPTON PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Telephones			
<i>Specification</i>			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

Swimming pools - accessibility can be via ramp, lifting device, or transfer area			
Ramp at least 34" wide with a non-slip surface extending into the shallow end, slope not exceeding 1:6 with handrails on both sides			POOL GRADUALLY SLOPES
lifting device			NO LIFTING DEVICE
Transfer area 18" above the path of travel and a minimum of 18" wide			NO LIFTING DEVICE
Unobstructed path of travel not less than 48" wide around pool			
Non-slip surface			

Showers rooms - showers must accommodate both wheel-in and transfer use			
Stalls 36" by 60" minimum, with 36" door opening			
Floors are pitched to drain the stall at the corner farthest from entrance			
Floors are non-slip surface			
Controls operate by a single lever with a pressure balance mixing valve			ONE BUTTON - TIMED
Controls are located on the center wall adjacent to the hinged seat			BELOW SHOWER HEAD - NO SEAT
Shower head attached to a flexible metal hose			WALL MOUNTED
Shower heads attached to wall mounting adjustable from 42" to 72" above the floor			WALL MOUNTED
Seat is hinged and padded and at least 16" deep, folds upward, securely attached to side wall, height is 18" to top of the seat, and at least 24" long			NO SEATS
Soap trays without handhold features unless they can support 250 pounds			NO TRAYS
2 grab bars are provided, one 30" and one 48" long or one continuous L shaped bar			1 2'-6" RAIL, 1 1'-3" RAIL
Grab bars are placed horizontally at 36" above the floor line			

SECTION 5

DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: RESTROOMS

	Yes	No	Comments
--	-----	----	----------

DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: GREEN ISLAND NEIGHBORHOOD CENTER

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
<i>Specification</i>			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			

DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: GREEN ISLAND NEIGHBORHOOD CENTER

	Yes	No	Comments
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near front with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A


DISTRICT: 4
LOCATION: CROMPTON PARK

BUILDING: GREEN ISLAND NEIGHBORHOOD CENTER

	Yes	No	Comments
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

CROMPTON PARK

Pool Bathrooms

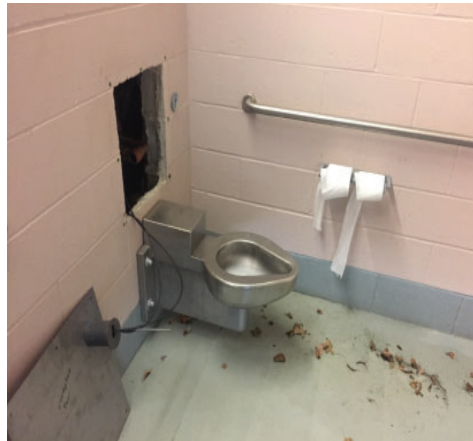

DISTRICT: 4
LOCATION: ELM PARK

BUILDING : RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			NONCOMPLIANT HARDWARE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			NONCOMPLIANT HARDWARE
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			2'-8" T.O. SINK
Extends at least 22" from the wall			

DISTRICT: 4
LOCATION: ELM PARK

BUILDING : RESTROOMS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			SWINGS IN
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			NONCOMPLIANT HARDWARE
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			Must reach over deep counter
			HAND DRYER AT 3'-6" ABOVE FLOOR
			Urinal 1'3" from floor
Floors, drinking fountains, telephones			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			Set 6" back from counter edge
Hand Operated push button or level controls			
Spouts located near from with stream of water as parallel to front as possible			
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 4

LOCATION: ELM PARK

BUILDING : RESTROOMS

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			OUTDATED SIGNAGE
Letters and numbers raised .03"			NO RAISING - NO BRAILLE
Letters and numbers contrast with the background color			

NOTES;

ELM PARK
Bathroom Building



DISTRICT: 5
LOCATION: FARBER FIELD

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
<i>Specification</i>			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			CRACKED/UNEVEN THRESHOLD
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			PEDESTAL
Extends at least 22" from the wall			

DISTRICT: 5
LOCATION: FARBER FIELD

BUILDING: RESTROOMS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			FINGER TURN FIXTURE
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			1'-5"
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			32"
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			NO MIRROR
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			MISSING FIXTURES


Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			FURNISHINGS AND PIPING OBSTRUCTING
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			
Spouts located near from with stream of water as parallel to front as possible			
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			

DISTRICT: 5
LOCATION: FARBER FIELD

BUILDING: RESTROOMS

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

FARBER FIELD
Bathroom / Concession
Building

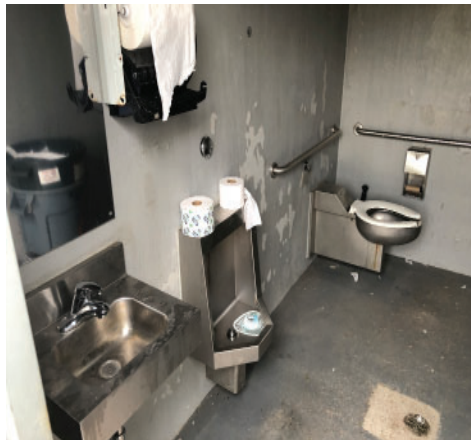

DISTRICT: 1
 LOCATION: **GREEN HILL PARK**
 SKYLINE DRIVE
 BUILDING: **ADMINISTRATION BUILDING**

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			NO BRAILLE SIGNS
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			No visual fire alarm system

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			

DISTRICT: 1
 LOCATION: **GREEN HILL PARK**
 SKYLINE DRIVE
 BUILDING: **ADMINISTRATION BUILDING**

	Yes	No	Comments
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			Doors onflict with when more than one is open at a time. Existing furnishings within clear space
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			

DISTRICT: 1

LOCATION: **GREEN HILL PARK**

SKYLINE DRIVE

BUILDING: **ADMINISTRATION BUILDING**

	Yes	No	Comments
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			

DISTRICT: 1
 LOCATION: **GREEN HILL PARK**
 SKYLINE DRIVE
 BUILDING: **ADMINISTRATION BUILDING**

	Yes	No	Comments
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

NOTES

ONE ADA BATHROOM FOR ENTIRE COMPLIANT FLOOR.

NO ADA COMPLIANT URINAL - THERE MUST BE 2
 MEETING ROOM B;

IF BACK OF ROOM IS PUBLIC/ USED BY STAFF OTHER THAN THE CITY'S IT MUST BE MADE ACCESSIBLE.

MOST NON-MEETING ROOM ROOMS HAVE FURNITURE OBSTRUCTING TURN RADIUS / CLEAR WIDTH.

IF OUTSIDE CATERING IS USED IN ROOM C THE KITCHEN MUST BE ACCESSIBLE.

COUNTER NON-COMPLIANT AT 36" HEIGHT.

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: GOLF CLUB HOUSE

T.O. = TOP OF

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			NO ADA SIGNAGE
Level space extending 5ft from the door, interior and exterior entrance doors			INTERIOR SPACE NOT CLEAR 5' DUE TO FURNITURE AND/OR CONSTRUCTED DIMENSION
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			FURNITURE OBSTRUCTS, BACK VESTIBULE TOO NARROW
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Door mats more than 1/2" thick are recessed			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO COMPLETE ALARM SYSTEM ADA SEAT AT BAR ADA SERVICE COUNTER
Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			INTERIOR DOORS CLEAR <32"
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			NO AUTO CLOSER ON BACK DOOR
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: GOLF CLUB HOUSE

T.O. = TOP OF

	Yes	No	Comments
Door adjacent to revolving door is accessible and unlocked			
Doors opening into hazardous area have hardware that is knurled or roughened			

Restrooms			
5ft turn space measured 12" from the floor			BACK HALLWAY MEASURES 4' WIDE FURNISHINGS CURRENTLY OBSTRUCTING ALL OTHER CLEAR TURN AROUND SPACE
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			FURNITURE OBSTRUCTING CLEAR SPACE - T.O. COUNTER 2'-9"
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			4'-1" CLEAR FROM DOOR SWING - 5'-8" FROM WALL - 4' FROM DOOR(ENTRY) TO SINK IN WOMENS
Stall door is 36" wide			MENS BATHROOM DOOR IS 2'-10"
Stall door swings out			DOOR SWINGS IN
Stall door is self closing			NO SELF CLOSING
Stall door has a pull latch			INSUFFICIENT
Lock on stall door is operable with a closed fist, and 32" above the floor			OUTDATED HARDWARE
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			1'-5" ALL
42" minimum clear space from center to farthest wall or fixture			3'-10" FROM TOILET TO SINK
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			2'-10" ALL
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			

DISTRICT: 1

LOCATION: **GREEN HILL PARK**BUILDING: **GOLF CLUB HOUSE**

T.O. = TOP OF

	Yes	No	Comments
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			SOAP DISPENSER LOCATED ~24" HORIZONTALLY AND ~1' VERTICALLY FROM COUNTER EDGE MENS URINAL CLEARANCE SPACE OVERLAPS WITH STALL DOOR CLEARANCE SPACE

Floors, drinking fountains, telephones			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			NO BRAILLE
Letters and numbers raised .03"			OUTDATED SIGNAGE
Letters and numbers contrast with the background color			

NOTES:

DISTRICT: 1
LOCATION: **GREEN HILL PARK**

BUILDING: **GOLF CLUB HOUSE**

T.O. = TOP OF

	Yes	No	Comments

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: CONNIE MACK LITTLE LEAGUE BUILDING

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			NO ACCESSIBLE SIGNAGE
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			2'-7", 2'-11"
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			KNOB HANDLE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			2'-7", 2'-11"
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			large heavy doors at entry
Maximum pressure 5 pounds interior doors			large heavy doors at entry
Threshold maximum 1/2" high, beveled on both sides			ALL >1/2"
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			KNOBS ONLY
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			OTHER DOOR SWINGS AND FURNISHINGS OBSTRUCT

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: CONNIE MACK LITTLE LEAGUE BUILDING

	Yes	No	Comments
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			sink is 2'7" in both mens and womens utility sink 3'-1"
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			OUTDATED HARDWARE
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			1'-8" to wall
42" minimum clear space from center to farthest wall or fixture			toilet to sink 36"
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			none
One mirror set a maximum 38" to bottom (if tilted 42")			none
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			none
Floors, drinking fountains, telephones			
Non-slip surface			sealed concrete
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: CONNIE MACK LITTLE LEAGUE BUILDING

	Yes	No	Comments
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			INCOMPLETE SIGNAGE
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			fixture heights greatly vary
Electrical outlets centered no lower than 18" above the floor			outlets vary from +/-1' from floor to >2'
Warnings signals must be visual as well as audible			INCOMPLETE ALARM SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: GOLF COURSE SNACK SHACK

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			NO ACCESSIBLE ENTRANCE OR SIGNAGE
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO COMPLETE ALARM SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			THRESHOLD HIGHER THAN 1/2"
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			NO LEVERS - JUST KNOBS OR HANDLES
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: GOLF COURSE SNACK SHACK

	Yes	No	Comments
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			DOOR SWINGS IN
Stall door is self closing			
Stall door has a pull latch			OUT OF DATE HARDWARE
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A

DISTRICT: 1

LOCATION: GREEN HILL PARK

BUILDING: GOLF COURSE SNACK SHACK

	Yes	No	Comments
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			
Spouts located near from with stream of water as parallel to front as possible			
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO COMPLETE ALARM SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

DISTRICT: 1

LOCATION: **GREEN HILL PARK**BUILDING: **FARM BARN**

BUILDING A



	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			
Door mats less than 1/2" thick are securely fastened			
Door mats more than 1/2" thick are recessed			
Grates in path of travel have openings of 1/2" maximum			LARGE GRATES SET IN TOO LARGE ROUGH OPENING
Signs at non-accessible entrance(S) indicate direction to accessible entrance			NO SIGNAGE
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO COMPLETE ALARM SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			N/A
Threshold maximum 1/2" high, beveled on both sides			THRESHOLDS 1"-3"+/-
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			DOOR KNOBS AND THUMB LATCHES
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			

DISTRICT: 1

LOCATION: **GREEN HILL PARK**BUILDING: **FARM BARN**

BUILDING A



	Yes	No	Comments
Entrances			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A
Restrooms			
5ft turn space measured 12" from the floor			N/A
At least one sink:			N/A
Clear floor space 30" by 48" to allow a forward approach			N/A
Mounted without pedestal or legs, height 34" to top of rim			N/A
Extends at least 22" from the wall			N/A
Open knee space a minimum 19" deep, 30" width, and 27" high			N/A
Cover exposed pipes with insulation			N/A
Faucets operable with closed fist (level or spring activated handle)			N/A
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			N/A
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			N/A
Toilet:			
18" from center to nearest side wall			N/A
42" minimum clear space from center to farthest wall or fixture			N/A
Top of seat 17"-19" above the floor			N/A
Grab Bars			
On back and side wall closest to toilet			N/A
1 1/4" diameter			N/A
1 1/2" clearance to wall			N/A
Located 30" above and parallel to the floor			N/A
Acid-etched or roughened surface			N/A
42" long			N/A
Fixtures			
Toilet paper dispenser is 24" above floor			N/A
One mirror set a maximum 38" to bottom (if tilted 42")			N/A
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			N/A
Floors, drinking fountains, telephones			
Non-slip surface			SEALED CONCRETE

DISTRICT: 1

LOCATION: **GREEN HILL PARK**BUILDING: **FARM BARN**

BUILDING A



	Yes	No	Comments
Entrances			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			MOST FURNISHINGS OBSTRUCT CLEAR SPACE
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			N/A
Electrical outlets centered no lower than 18" above the floor			N/A
Warnings signals must be visual as well as audible			N/A
Signs, Signals, and Switches			N/A
Mounting height must be 60" to centerline of the sign			N/A
Within 18" of door jamb or recessed			N/A
Letters and numbers at least 1 1/4" high			N/A
Letters and numbers raised .03"			N/A
Letters and numbers contrast with the background color			N/A

DISTRICT: 1
LOCATION: GREEN HILL PARK

BUILDING: FARM RESTROOMS
BUILDING B



	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			N/A
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			N/A

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			

DISTRICT: 1
LOCATION: **GREEN HILL PARK**

BUILDING: **FARM RESTROOMS**
BUILDING B



	Yes	No	Comments
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			2'9" SINK
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			1'-8"
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones

DISTRICT: 1
LOCATION: GREEN HILL PARK

BUILDING: FARM RESTROOMS
BUILDING B



	Yes	No	Comments
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

DISTRICT: 1
LOCATION: **GREEN HILL PARK**

FARM BATHROOMS - LOWER LEVEL

BUILDING C



	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			
Door mats less than 1/2" thick are securely fastened			
Door mats more than 1/2" thick are recessed			
Grates in path of travel have openings of 1/2" maximum			
Signs at non-accessible entrance(S) indicate direction to accessible entrance			
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			
Doors opening into hazardous area have hardware that is knurled or roughened			

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			

DISTRICT: 1
LOCATION: **GREEN HILL PARK**

FARM BATHROOMS - LOWER LEVEL



BUILDING C

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones

Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			

Drinking fountains

Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A

Telephones

Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

Signs, Signals, and Switches

DISTRICT: 1
LOCATION: **GREEN HILL PARK**

FARM BATHROOMS - LOWER LEVEL



BUILDING C

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			


GREEN HILL PARK
Connie Mack
Concession Building



GREEN HILL PARK
Farm Barn House




GREEN HILL PARK
Farm Restrooms

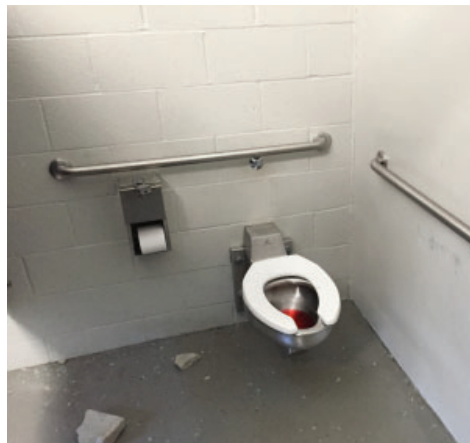

GREEN HILL PARK
Golf Club House



GREEN HILL PARK
Golf Club Snack Shack

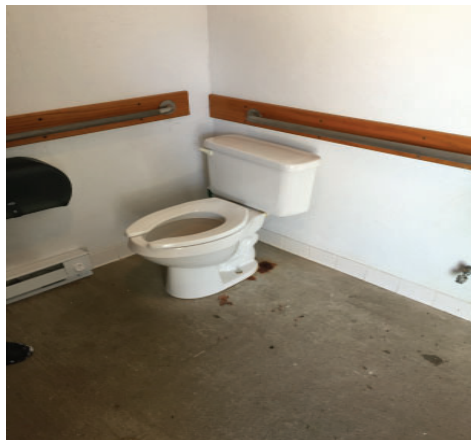

GREEN HILL PARK Administration Building



DISTRICT: 3

LOCATION: GREENWOOD PARK

BUILDING: SPLASH ZONE RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			

DISTRICT: 3

LOCATION: GREENWOOD PARK

BUILDING: SPLASH ZONE RESTROOMS

	Yes	No	Comments
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			DEDICATED RESTROOM INSTEAD OF STALL
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			MISSING FIXTURES

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
<i>Specification</i>			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			

DISTRICT: 3

LOCATION: GREENWOOD PARK

BUILDING: SPLASH ZONE RESTROOMS

	Yes	No	Comments
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			N/A
Electrical outlets centered no lower than 18" above the floor			N/A
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			N/A
Within 18" of door jamb or recessed			N/A
Letters and numbers at least 1 1/4" high			N/A
Letters and numbers raised .03"			N/A
Letters and numbers contrast with the background color			N/A

GREENWOOD PARK
Caretakers / bathhouse
(Abandoned)



DISTRICT: 4

LOCATION: HARRY SHERRY FIELD

BUILDING: LITTLE LEAGUE CONCESSIONS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			UNEVEN THRESHOLD
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			

DISTRICT: 4

LOCATION: HARRY SHERRY FIELD

BUILDING: LITTLE LEAGUE CONCESSIONS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A

DISTRICT: 4

LOCATION: HARRY SHERRY FIELD

BUILDING: LITTLE LEAGUE CONCESSIONS

	Yes	No	Comments
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

SECTION 11

DISTRICT: 4

LOCATION: HARRY SHERRY FIELD

BUILDING: LITTLE LEAGUE CONCESSIONS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			
Treads no less than 11" wide			
Handrails on both sides			NO RAILS
Handrails 34"-38" above tread			NO RAILS
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			NO RAILS
Handgrip oval or round			NO RAILS
Handgrip has a smooth surface			NO RAILS
Handgrip diameter between 1 1/4" and 1 1/2"			NO RAILS
1 1/2" clearance between wall and handrail			NO RAILS
Doors			
Minimum 32" clear opening			BATHROOM DOOR AT 2'-4"
At least 18" clear floor space on pull side of door			VARIOUS CONDITIONS
Closing speed minimum 3 seconds to within 3" of the latch			NO CLOSERS
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			SOME DOORS LOCATED IN NARROW HALLWAY
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

SECTION 11

DISTRICT: 4

LOCATION: HARRY SHERRY FIELD

BUILDING: LITTLE LEAGUE CONCESSIONS

	Yes	No	Comments
--	-----	----	----------

SECTION 11

Restrooms			
5ft turn space measured 12" from the floor			TOTAL ROOM DIM 5'X6'
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			ROOM TOO NARROW AT 5'X6'
Mounted without pedestal or legs, height 34" to top of rim			PEDESTAL
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			PEDESTAL
Cover exposed pipes with insulation			PEDESTAL
Faucets operable with closed fist (level or spring activated handle)			FINGER TWIST CONTROLS
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			RESIDENTIAL RESTROOM
Stall door is 36" wide			2'-4" DOOR
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			RESIDENTIAL RESTROOM
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			RESIDENTIAL TOILET
42" minimum clear space from center to farthest wall or fixture			RESIDENTIAL TOILET
Top of seat 17"-19" above the floor			RESIDENTIAL TOILET
Grab Bars			
On back and side wall closest to toilet			NO BARS
1 1/4" diameter			NO BARS
1 1/2" clearance to wall			NO BARS
Located 30" above and parallel to the floor			NO BARS
Acid-etched or roughened surface			NO BARS
42" long			NO BARS
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			FURNITURE OBSTRUCTING
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A

SECTION 11

DISTRICT: 4

LOCATION: HARRY SHERRY FIELD

BUILDING: LITTLE LEAGUE CONCESSIONS

	Yes	No	Comments
Hand Operated push button or level controls			N/A
SECTION 11			
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO COMPLETE SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO COMPLIANT SIGNAGE
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

HARRY SHERRY FIELD
Little League
Concessions



HARRY SHERRY FIELD Neighborhood Center



DISTRICT:

LOCATION: HOPE CEMETERY

BUILDING: ADMIN BUILDING

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			CRUMBLING THRESHOLD
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			NOT FASTENED
Door mats more than 1/2" thick are recessed			
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed first (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			

DISTRICT:

LOCATION: HOPE CEMETERY

BUILDING: ADMIN BUILDING

	Yes	No	Comments
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			WOMEN'S 1'-4"
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			3'
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			4'-2" PAPER TOWEL DISPENSERS, 3' SOAP DISPENSER
			1'-1" URINAL

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			N/A

DISTRICT:

LOCATION: HOPE CEMETERY

BUILDING: ADMIN BUILDING

	Yes	No	Comments
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

HOPE CEMETERY
Administration Building



LOCATION: INDIAN LAKE BEACH

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			4" Threshold
Level space extending 5ft from the door, interior and exterior entrance doors			not level
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			30" clear width
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
<i>Specification</i>			
Minimum 32" clear opening			2'6" door opening
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			4" threshold
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			

LOCATION: INDIAN LAKE BEACH

BUILDING: RESTROOMS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			NO GRAB BARS
1 1/4" diameter			NO GRAB BARS
1 1/2" clearance to wall			NO GRAB BARS
Located 30" above and parallel to the floor			NO GRAB BARS
Acid-etched or roughened surface			NO GRAB BARS
42" long			NO GRAB BARS
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			no mirror
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			no mounted dispensers

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			

LOCATION: INDIAN LAKE BEACH

BUILDING: RESTROOMS

	Yes	No	Comments
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

Notes:

Life guard area does not comply with fixture heights ad pipe insulating

INDIAN LAKE
Restroom Building



DISTRICT: 2

LOCATION: INSTITUTE PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			ANGLED PARTITION WALL OBSTRUCTS - BOTH
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
<i>Specification</i>			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			>5LB
Threshold maximum 1/2" high, beveled on both sides			3/4" - 1"
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A

DISTRICT: 2

LOCATION: INSTITUTE PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
<i>Specification</i>			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			4'10" x 6'
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			NO MIRROR JUST CHROMED METAL
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			HAND DRYER

Floors, drinking fountains, telephones			
floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			

DISTRICT: 2

LOCATION: INSTITUTE PARK

BUILDING: RESTROOMS

	Yes	No	Comments
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
<i>Specification</i>			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

DISTRICT: 2

LOCATION: INSTITUTE PARK

BUILDING: BAND SHELL

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			NO ACCESSIBLE PATH/RAMP
Level space extending 5ft from the door, interior and exterior entrance doors			no landing
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			N/A
At least 18" clear floor area on latch, pull side of door			N/A
Door handle no higher than 48" and operable with a closed fist			N/A
Vestibule is 4ft plus the width of the door swinging into the space			N/A
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			N/A

Stairs and Doors			
No open risers			
Treads no less than 11" wide			
Handrails on both sides			rails only on one side of stair
Handrails 34"-38" above tread			no handrail, just guardrail
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			no extension
Handgrip oval or round			no handrail, just guardrail
Handgrip has a smooth surface			no handrail, just guardrail
Handgrip diameter between 1 1/4" and 1 1/2"			no handrail, just guardrail
1 1/2" clearance between wall and handrail			N/A
Doors			
<i>Specification</i>			
Minimum 32" clear opening			N/A
At least 18" clear floor space on pull side of door			N/A
Closing speed minimum 3 seconds to within 3" of the latch			N/A
Maximum pressure 5 pounds interior doors			N/A
Threshold maximum 1/2" high, beveled on both sides			N/A
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			N/A
Hardware minimum 36", maximum 48" above the floor			N/A
Clear, level floor space extends out 5ft from both sides of the door			N/A
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			N/A
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			N/A
Mounted without pedestal or legs, height 34" to top of rim			N/A
Extends at least 22" from the wall			N/A

DISTRICT: 2

LOCATION: INSTITUTE PARK

BUILDING: BAND SHELL

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			N/A
Cover exposed pipes with insulation			N/A
Faucets operable with closed fist (level or spring activated handle)			N/A
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			N/A
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			N/A
42" minimum clear space from center to farthest wall or fixture			N/A
Top of seat 17"-19" above the floor			N/A
Grab Bars			
On back and side wall closest to toilet			N/A
1 1/4" diameter			N/A
1 1/2" clearance to wall			N/A
Located 30" above and parallel to the floor			N/A
Acid-etched or roughened surface			N/A
42" long			N/A
Fixtures			
Toilet paper dispenser is 24" above floor			N/A
One mirror set a maximum 38" to bottom (if tilted 42")			N/A
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			N/A

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			N/A
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			N/A
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 2
LOCATION: INSTITUTE PARK

BUILDING: BAND SHELL

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			N/A
Electrical outlets centered no lower than 18" above the floor			N/A
Warnings signals must be visual as well as audible			N/A
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			N/A
Within 18" of door jamb or recessed			N/A
Letters and numbers at least 1 1/4" high			N/A
Letters and numbers raised .03"			N/A
Letters and numbers contrast with the background color			N/A

INSTITUTE PARK
Restroom Building



INSTITUTE PARK
Band-shell



DISTRICT:

LOCATION: LAKE PARK

BUILDING: Grounds Keeper Building

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			CRACKED UNEVEN THRESHOLD
Level space extending 5ft from the door, interior and exterior entrance doors			CRACKED AND UNEVEN PAVEMENT
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			OVERHEAD DOOR (OHD)
At least 18" clear floor area on latch, pull side of door			N/A
Door handle no higher than 48" and operable with a closed fist			OVERHEAD DOOR PULL HANDLE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO VISUAL FIRE ALARM SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			OHD, 1 INTERIOR DOOR
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			OHD - MANUAL ROLLING
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			OHD- CRACKED UNEVEN THRESHOLD
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			OHD PULL HANDLE
Hardware minimum 36", maximum 48" above the floor			OHD HARDWARE - NO PERSONNEL DOOR ACCESS
Clear, level floor space extends out 5ft from both sides of the door			CRACKED AND UNEVEN PAVEMENT
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Grab Bars			
5ft turn space measured 12" from the floor			ROOM IS > 5' CLEAR WIDE
At least one sink:			

DISTRICT:

LOCATION: LAKE PARK

BUILDING: Grounds Keeper Building

	Yes	No	Comments
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			RESIDENTIAL STORAGE PEDESTAL
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			NO OPEN KNEE SPACE
Cover exposed pipes with insulation			NONCOMPLIANT SINK ASSEMBLY
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			NO 5' DIAMETER TURN AROUND
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			NO GRAB BARS
1 1/4" diameter			NO GRAB BARS
1 1/2" clearance to wall			NO GRAB BARS
Located 30" above and parallel to the floor			NO GRAB BARS
Acid-etched or roughened surface			NO GRAB BARS
42" long			NO GRAB BARS
Fixtures			
Toilet paper dispenser is 24" above floor			NO DISPENSER
One mirror set a maximum 38" to bottom (if tilted 42")			MIRROR >38"
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			ALL DISPENSERS >42" - SOME MISSING/UNUSABLE

Floors, drinking fountains, telephones			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			VARIOUS TYPES OF EXPOSED UTILITY LINES AROUND INTERIOR PERIMETER
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A

DISTRICT:

LOCATION: **LAKE PARK**BUILDING: **Grounds Keeper Building**

	Yes	No	Comments
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			VARIOUS TYPES OF EXPOSED UTILITY LINES AND RELATED CONTROLS AROUND INTERIOR PERIMETER
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO VISUAL ALARM SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

NOTES

DISTRICT:

LOCATION: LAKE PARK

BUILDING: Bathrooms

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO VISUAL ALARM SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			2'-6" DOOR
At least 18" clear floor space on pull side of door			DOOR SWING CLEARANCES CONFLICT - FURNISHINGS OBSTRUCTING CLEAR SPACE
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			4" THRESHOLD
Hardware operable with a closed first (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			DOOR SWING CLEARANCES CONFLICT - FURNISHINGS OBSTRUCTING CLEAR SPACE
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms

DISTRICT:

LOCATION: **LAKE PARK**BUILDING: **Bathrooms**

	Yes	No	Comments
5ft turn space measured 12" from the floor			SINK AREA 3'-9" WIDE
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			SINK AREA 3'-9" WIDE
Mounted without pedestal or legs, height 34" to top of rim			2'-3"
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			2'-3"
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			TURN KNOB CONTROLS
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			RESTROOM STALLS ARE 3'x4'-4"
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOKS
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			34" FROM TOILET TO PARTITION (4'-4" TOTAL STALL DEPTH)
Top of seat 17"-19" above the floor			20" high
Grab Bars			
On back and side wall closest to toilet			NO GRAB BARS
1 1/4" diameter			NO GRAB BARS
1 1/2" clearance to wall			NO GRAB BARS
Located 30" above and parallel to the floor			NO GRAB BARS
Acid-etched or roughened surface			NO GRAB BARS
42" long			NO GRAB BARS
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			NO SOAP DISPENSER, NO USABLE TOILET PAPER DISPENSER
			URINALS > 1'-6" HEIGHT

Floors, drinking fountains, telephones			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A

DISTRICT:

LOCATION: **LAKE PARK**BUILDING: **Bathrooms**

	Yes	No	Comments
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO VISUAL ALARM SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			SIGNS MOUNTED ABOVE DOORS
Within 18" of door jamb or recessed			SIGNS MOUNTED ABOVE DOORS
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			OUTDATED SIGNAGE
Letters and numbers contrast with the background color			

NOTES

LIFEGUARD AREA COMPLIES - MOVABLE FURNISHINGS OBSTRUCT

DISTRICT: 5
 LOCATION: LOGAN FIELD
 MILL ST
 BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			BATHROOMS CRACKED THRESHOLD - UNEVEN
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			Hand dryer and paper towel dispenser measured to be 3'-10" from floor
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			NO FALL PROTECTION OR DIVISION FROM UTILITY CORRIDOR

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			Measured at 2'-7"
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			

DISTRICT: 5
 LOCATION: LOGAN FIELD
 MILL ST
 BUILDING: RESTROOMS

	Yes	No	Comments
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			Women's room guardrail measured 2'-8"
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			no mirrors
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			3'10" height at least
			URINAL 1'-5"

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			Push button
SECTION 16			
Spouts located near from with stream of water as parallel to front as possible			NOT PARALLEL
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 5
 LOCATION: LOGAN FIELD
 MILL ST
 BUILDING: RESTROOMS

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

DISTRICT: 5
 LOCATION: LOGAN FIELD
 MILL ST
 BUILDING: CONCESSIONS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
<i>Specification</i>			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
			TEMP BOX 8" THRESHOLD
			STORAGE 1'-3/4" THRESHOLD
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			LATCHES AT INTERIOR DOORS
Hardware minimum 36", maximum 48" above the floor			VARIOUS MOUNTING HEIGHTS THROUGHOUT
Clear, level floor space extends out 5ft from both sides of the door			Hand dryer and paper towel dispenser measured to be 3'-10" from floor
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A
5ft turn space measured 12" from the floor			N/A
At least one sink:			


DISTRICT: 5
 LOCATION: LOGAN FIELD
 MILL ST
 BUILDING: CONCESSIONS

	Yes	No	Comments
Clear floor space 30" by 48" to allow a forward approach			FURNITURE OBSTRUCTING
Mounted without pedestal or legs, height 34" to top of rim			N/A
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			CLEAR SPACE OBSTRUCTED BY PIPES OR FURNITURE
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			N/A
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			N/A
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			N/A
Top of seat 17"-19" above the floor			N/A
Grab Bars			
On back and side wall closest to toilet			N/A
1 1/4" diameter			N/A
1 1/2" clearance to wall			N/A
Located 30" above and parallel to the floor			N/A
Acid-etched or roughened surface			N/A
42" long			N/A
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			N/A
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			N/A
Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			Push button
Spouts located near from with stream of water as parallel to front as possible			NOT PARALLEL
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			

DISTRICT: 5
 LOCATION: LOGAN FIELD
 MILL ST
 BUILDING: CONCESSIONS

	Yes	No	Comments
<i>Specification</i>			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

LOGAN FIELD
Restroom / Concession
Building

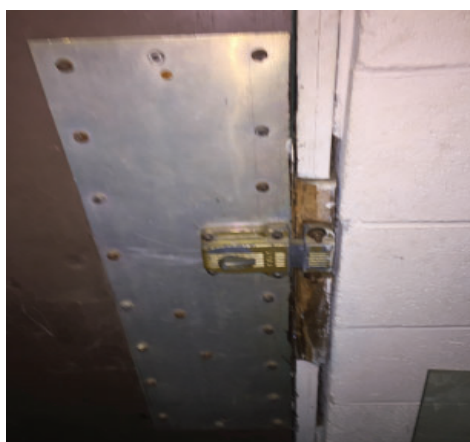

DISTRICT: 3

LOCATION: MULCAHY FIELD

BUILDING: RESTROOMS & CONCESSION

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			EXTERIOR WALK <5' WIDE CLEAR
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

DISTRICT: 3

LOCATION: MULCAHY FIELD

BUILDING: RESTROOMS & CONCESSION

	Yes	No	Comments
Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
			TOILET FLUSH BUTTON 42" ABOVE FLOOR
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			LOCATED 33" ABOVE FLOOR
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			NO TP DISPENSER
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			MISSING FIXTURES
Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A

DISTRICT: 3

LOCATION: MULCAHY FIELD

BUILDING: RESTROOMS & CONCESSION

	Yes	No	Comments
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

MULCAHY FIELD
Restroom / Concession
Building



DISTRICT:

LOCATION: NEWTON SQUARE

BUILDING: RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			CRACKS AT ALL THRESHOLDS
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM
Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A
Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			SINKS 2'-7", 2'-8"

DISTRICT:

LOCATION: NEWTON SQUARE

BUILDING: RESTROOMS

	Yes	No	Comments
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			HAND DRYERS 3'-10"

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A

DISTRICT:

LOCATION: NEWTON SQUARE

BUILDING: RESTROOMS

	Yes	No	Comments
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

NOTES;

Maintenance room complies

NEWTON SQUARE
Restroom / Storage
Building



DISTRICT: 5
LOCATION: ROCKWOOD FIELD

JESSE BURKETT LITTLE LEAGUE FIELD CONCESSIONS AND
PRESSBOX

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			VARIOUS FINGER OPERATED LATCHES
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEMS

Stairs and Doors			
No open risers			
Treads no less than 11" wide			
Handrails on both sides			ONE SIDE
Handrails 34"-38" above tread			
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			NONCOMPLIANT HANDRAIL ASSEMBLY
Handgrip oval or round			NONCOMPLIANT HANDRAIL ASSEMBLY
Handgrip has a smooth surface			NONCOMPLIANT HANDRAIL ASSEMBLY
Handgrip diameter between 1 1/4" and 1 1/2"			NONCOMPLIANT HANDRAIL ASSEMBLY
1 1/2" clearance between wall and handrail			NONCOMPLIANT HANDRAIL ASSEMBLY
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			LATCH DOORS AND KNOBS
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			FURNITURE OBSTRUCTION AND/OR BUILT DIMENSIONS
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			FURNITURE OBSTRUCTION AND/OR BUILT DIMENSIONS
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			

DISTRICT: 5
LOCATION: ROCKWOOD FIELD

JESSE BURKETT LITTLE LEAGUE FIELD CONCESSIONS AND
PRESSBOX

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			FINGER CONTROL LOCK
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			FURNITURE OBSTRUCTION AND/OR BUILT DIMENSIONS
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			NO GRAB BARS
1 1/4" diameter			NO GRAB BARS
1 1/2" clearance to wall			NO GRAB BARS
Located 30" above and parallel to the floor			NO GRAB BARS
Acid-etched or roughened surface			NO GRAB BARS
42" long			NO GRAB BARS
Fixtures			
Toilet paper dispenser is 24" above floor			NO DISPENSER
One mirror set a maximum 38" to bottom (if tilted 42")			NO MIRROR
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			BOTTOM OF SOAP DISPENSER AND PAPER TOWEL DISPENSER >42"

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			CONCESSIONS AREA >3' CLEARANCE DUE TO BUILT CONDITIONS AND FURNITURE/EQUIPMENT OBSTRUCTIONS
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			FURNITURE, EQUIPMENT, SHELVES, DUCT WORK, PIPING
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near front with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
<i>Specification</i>			

DISTRICT: 5
LOCATION: ROCKWOOD FIELD

JESSE BURKETT LITTLE LEAGUE FIELD CONCESSIONS AND
PRESSBOX

	Yes	No	Comments
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			ON DOOR
Within 18" of door jamb or recessed			ON DOOR
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			OUTDATED SIGNAGE
Letters and numbers contrast with the background color			

NOTE:

PRESSBOX ACCESSIBLE ONLY BY STAIRS - NOT EVALUATED FOR ACCESSIBILITY

DISTRICT: 5
LOCATION: ROCKWOOD FIELD

RAYMOND FIELD SOFTBALL BUILDING - PRESSBOX AND
CONCESSIONS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			LATCH
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEMS

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			RAMP RAILS
Handrails 34"-38" above tread			RAMP RAILS
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			RAMP RAILS
Handgrip oval or round			RAMP RAILS
Handgrip has a smooth surface			RAMP RAILS
Handgrip diameter between 1 1/4" and 1 1/2"			RAMP RAILS
1 1/2" clearance between wall and handrail			RAMP RAILS
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			LATCH
Hardware minimum 36", maximum 48" above the floor			CONCESSION WINDOW
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			N/A
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			N/A
Mounted without pedestal or legs, height 34" to top of rim			N/A
Extends at least 22" from the wall			N/A

DISTRICT: 5
LOCATION: ROCKWOOD FIELD

RAYMOND FIELD SOFTBALL BUILDING - PRESSBOX AND
CONCESSIONS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			N/A
Cover exposed pipes with insulation			N/A
Faucets operable with closed fist (level or spring activated handle)			N/A
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			N/A
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			N/A
Toilet:			
18" from center to nearest side wall			N/A
42" minimum clear space from center to farthest wall or fixture			N/A
Top of seat 17"-19" above the floor			N/A
Grab Bars			
On back and side wall closest to toilet			N/A
1 1/4" diameter			N/A
1 1/2" clearance to wall			N/A
Located 30" above and parallel to the floor			N/A
Acid-etched or roughened surface			N/A
42" long			N/A
Fixtures			
Toilet paper dispenser is 24" above floor			N/A
One mirror set a maximum 38" to bottom (if tilted 42")			N/A
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			N/A

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			TILE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			COUNTERS, FURNISHINGS, DUCTS, PIPING
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 5

LOCATION: ROCKWOOD FIELD

RAYMOND FIELD SOFTBALL BUILDING - PRESSBOX AND
CONCESSIONS

	Yes	No	Comments
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

NOTE:

OLD CARE TAKER'S BUILDING AND HISTORIC RESTROOM BUILDING ARE RECOMMENDED TO BE DEMOLISHED

DISTRICT: 5

LOCATION: ROCKWOOD FIELD

LITTLE LEAGUE STORAGE BUILDING

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			OVERHEAD DOOR (OHD) PULL UP HARDWARE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEMS

Stairs and Doors			
No open risers			
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			OVERHEAD DOOR
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			MANUAL OVERHEAD DOOR
Maximum pressure 5 pounds interior doors			N/A
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			OVERHEAD DOOR (OHD) PULL UP HARDWARE
Hardware minimum 36", maximum 48" above the floor			OVERHEAD DOOR (OHD) PULL UP HARDWARE
Clear, level floor space extends out 5ft from both sides of the door			EQUIPMENT OBSTRUCTION INSIDE
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			N/A
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			N/A
Mounted without pedestal or legs, height 34" to top of rim			N/A
Extends at least 22" from the wall			N/A

DISTRICT: 5
LOCATION: ROCKWOOD FIELD

LITTLE LEAGUE STORAGE BUILDING

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			N/A
Cover exposed pipes with insulation			N/A
Faucets operable with closed fist (level or spring activated handle)			N/A
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			N/A
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			N/A
Coat hook is 54" high			N/A
Toilet:			
18" from center to nearest side wall			N/A
42" minimum clear space from center to farthest wall or fixture			N/A
Top of seat 17"-19" above the floor			N/A
Grab Bars			
On back and side wall closest to toilet			N/A
1 1/4" diameter			N/A
1 1/2" clearance to wall			N/A
Located 30" above and parallel to the floor			N/A
Acid-etched or roughened surface			N/A
42" long			N/A
Fixtures			
Toilet paper dispenser is 24" above floor			N/A
One mirror set a maximum 38" to bottom (if tilted 42")			N/A
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			N/A

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 5

LOCATION: ROCKWOOD FIELD

LITTLE LEAGUE STORAGE BUILDING

	Yes	No	Comments
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			NONE
Electrical outlets centered no lower than 18" above the floor			NONE
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

ROCKWOOD FIELD
Jesse Burkett Little League Field
Concessions and Pressbox



DISTRICT: 1

LOCATION: SHORE PARK

BUILDING: RESTROOMS & LIFEGUARD ROOM

	Yes	No	Comments
Entrances			
Signs at non-accessible entrance(S) indicate direction to accessible entrance			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			no alarm system

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			2'-10" all doors
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			

DISTRICT: 1

LOCATION: SHORE PARK

BUILDING: RESTROOMS & LIFEGUARD ROOM

	Yes	No	Comments
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			35" above floor
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			no mirror
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A

DISTRICT: 1

LOCATION: SHORE PARK

BUILDING: RESTROOMS & LIFEGUARD ROOM

	Yes	No	Comments
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			
Within 18" of door jamb or recessed			
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			
Letters and numbers contrast with the background color			

SHORE PARK
Restroom / Lifeguard
Building



DISTRICT: 5
LOCATION: COES PARK

BUILDING: STEARNS TAVERN

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			SMALL SIGNAGE APPROX. 6"X12", NOT CLEARLY VISIBLE
Level space extending 5ft from the door, interior and exterior entrance doors			EXTERIOR BATHROOMS - 4" CLEAR SIDEWALK WIDTH
			INTERIOR BATHROOMS - 3' WIDTH HALLWAY
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			ALL - FINGER LATCH LOCK
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A

Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			NO CLOSER
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

SECTION 21

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			INTERIOR BATHROOMS - PEDESTAL RESIDENTIAL SINKS
Extends at least 22" from the wall			

DISTRICT: 5
LOCATION: COES PARK

BUILDING: STEARNS TAVERN

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			PEDESTAL RESIDENTIAL SINKS
Cover exposed pipes with insulation			N/A
Faucets operable with closed fist (level or spring activated handle)			KNOBS
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			INTERIOR - 6'10" x 4'4"
Stall door is 36" wide			
Stall door swings out			INTERIOR BATHROOM
Stall door is self closing			INTERIOR BATHROOM
Stall door has a pull latch			INTERIOR BATHROOM
Lock on stall door is operable with a closed fist, and 32" above the floor			INTERIOR BATHROOM
Coat hook is 54" high			ALL - NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			PORCELAIN RESIDENTIAL TOILET
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			1" DIAMETER
1 1/2" clearance to wall			2"
Located 30" above and parallel to the floor			ALL BATHROOMS - 3'-0" GUARD RAILS
Acid-etched or roughened surface			BRONZE PAINTED METAL
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			FAMILY BATHROOM #1 - 3'-0", 3'-8" HIGH SOAP DISPENSER, HAND DRYER
			FAMILY BATHROOM #2 - 3'-8" TO HAND DRYER BUTTON

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			THICK CARPETS, NOT SECURED AT EDGES
Corridor width minimum is 3ft			
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			INTERIOR BATHROOMS - FLOOR HEATER UNITS OBSTRUCT, FURNISHINGS OBSTRUCT
SECTION 21			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			

DISTRICT: 5

LOCATION: COES PARK

BUILDING: STEARNS TAVERN

	Yes	No	Comments
Highest operating part a maximum 54" above the floor			NO PUBLIC PHONES
Access within 12" of phone, 30" high by 30" width			NO PUBLIC PHONES
Adjustable volume control on headset so identified			NO PUBLIC PHONES
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO COMPLETE ALARM SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

COES PARK
Stearns Tavern



DISTRICT: 5
LOCATION: TY COBB PARK

BUILDING: RESTROOMS & CONCESSIONS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			<5' SIDEWALK
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			INDUSTRIAL HANDLES
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
No open risers			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Treads no less than 11" wide			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Handrails on both sides			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Handrails 34"-38" above tread			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Handgrip oval or round			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Handgrip has a smooth surface			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Handgrip diameter between 1 1/4" and 1 1/2"			UPSTAIRS NOT ACCESSIBLE/PUBLIC
1 1/2" clearance between wall and handrail			UPSTAIRS NOT ACCESSIBLE/PUBLIC
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			PEDESTAL
Extends at least 22" from the wall			

DISTRICT: 5
LOCATION: TY COBB PARK

BUILDING: RESTROOMS & CONCESSIONS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			
Stall door swings out			
Stall door is self closing			
Stall door has a pull latch			
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOKS
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			1'-2" RESIDENTIAL TOILETS
Grab Bars			
On back and side wall closest to toilet			NO GRAB BARS
1 1/4" diameter			NO GRAB BARS
1 1/2" clearance to wall			NO GRAB BARS
Located 30" above and parallel to the floor			NO GRAB BARS
Acid-etched or roughened surface			NO GRAB BARS
42" long			NO GRAB BARS
Fixtures			
Toilet paper dispenser is 24" above floor			2'-10"
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones			
floors:			
Non-slip surface			
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A

DISTRICT: 5
LOCATION: TY COBB PARK

BUILDING: RESTROOMS & CONCESSIONS

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			> 60"
Within 18" of door jamb or recessed			SIGNS MOUNTED ON DOORS
Letters and numbers at least 1 1/4" high			
Letters and numbers raised .03"			NO BRAILLE
Letters and numbers contrast with the background color			OUT DATED SIGNAGE

TY COBB PARK
Restroom / Concession Building



DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: LITTLE LEAGUE RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			INDUSTRIAL HANDLE
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
<i>Specification</i>			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			OBSTRUCTED
Mounted without pedestal or legs, height 34" to top of rim			2'-8"
Extends at least 22" from the wall			

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: LITTLE LEAGUE RESTROOMS

	Yes	No	Comments
Open knee space a minimum 19" deep, 30" width, and 27" high			
Cover exposed pipes with insulation			NO INSULATION
Faucets operable with closed fist (level or spring activated handle)			NONCOMPLIANT HARDWARE
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			NONCOMPLIANT HARDWARE
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			3'
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			NO MIRROR
Dispenser (towel, soap, etc.) at least one of each a maximum 42" above the floor			MISSING FIXTURE

Floors, drinking fountains, telephones			
Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: LITTLE LEAGUE RESTROOMS

	Yes	No	Comments
Switches, Controls, and Signs			
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc., must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE
Within 18" of door jamb or recessed			NO SIGNAGE
Letters and numbers at least 1 1/4" high			NO SIGNAGE
Letters and numbers raised .03"			NO SIGNAGE
Letters and numbers contrast with the background color			NO SIGNAGE

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: SOFTBALL CONCESSIONS AND RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			INCOMPLETE SIGNAGE
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			INCOMPLETE SIGNAGE
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			INCOMPLETE SIGNAGE

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: SOFTBALL CONCESSIONS AND RESTROOMS

	Yes	No	Comments
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			NONCOMPLIANT FINGER TURN HARDWARE
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			NO MIRROR
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			FIXTURES >42"

Floors, drinking fountains, telephones

Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			
Hand Operated push button or level controls			
Spouts located near from with stream of water as parallel to front as possible			NOT PARALLEL ~45 DEGREE
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			B.O. FIXTURE ~20"
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Switches, Controls, and Signs			

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: SOFTBALL CONCESSIONS AND RESTROOMS

	Yes	No	Comments
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			ON DOOR
Within 18" of door jamb or recessed			ON DOOR
Letters and numbers at least 1 1/4" high			ONLY 1 OUT OF 2 SIGNS PRESENT - SIGN OUTDATED
Letters and numbers raised .03"			ONLY 1 OUT OF 2 SIGNS PRESENT - SIGN OUTDATED
Letters and numbers contrast with the background color			ONLY 1 OUT OF 2 SIGNS PRESENT - SIGN OUTDATED

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: BASEBALL RESTROOMS

	Yes	No	Comments
Entrances			
Primary public entrances accessible to person using wheelchair, must be signed, gotten to independently, and not be the service entrance.			
Level space extending 5ft from the door, interior and exterior entrance doors			
Minimum 32" clear width opening (i.e. 36" door with standard hinge)			
At least 18" clear floor area on latch, pull side of door			
Door handle no higher than 48" and operable with a closed fist			
Vestibule is 4ft plus the width of the door swinging into the space			
Entrance(s) on a level that makes elevators accessible			N/A
Door mats less than 1/2" thick are securely fastened			N/A
Door mats more than 1/2" thick are recessed			N/A
Grates in path of travel have openings of 1/2" maximum			N/A
Signs at non-accessible entrance(S) indicate direction to accessible entrance			N/A
Emergency egress - alarms with flashing lights and audible signals, sufficiently lighted			NO SYSTEM

Stairs and Doors			
No open risers			N/A
Treads no less than 11" wide			N/A
Handrails on both sides			N/A
Handrails 34"-38" above tread			N/A
Handrail extends a minimum of 1ft beyond top and bottom riser (if no safety hazard permits)			N/A
Handgrip oval or round			N/A
Handgrip has a smooth surface			N/A
Handgrip diameter between 1 1/4" and 1 1/2"			N/A
1 1/2" clearance between wall and handrail			N/A
Doors			
Minimum 32" clear opening			
At least 18" clear floor space on pull side of door			
Closing speed minimum 3 seconds to within 3" of the latch			
Maximum pressure 5 pounds interior doors			N/A
Threshold maximum 1/2" high, beveled on both sides			
Hardware operable with a closed fist (no conventional door knobs or thumb latch devices)			
Hardware minimum 36", maximum 48" above the floor			
Clear, level floor space extends out 5ft from both sides of the door			
Door adjacent to revolving door is accessible and unlocked			N/A
Doors opening into hazardous area have hardware that is knurled or roughened			N/A

Restrooms			
5ft turn space measured 12" from the floor			
At least one sink:			
Clear floor space 30" by 48" to allow a forward approach			
Mounted without pedestal or legs, height 34" to top of rim			2'-8"
Extends at least 22" from the wall			
Open knee space a minimum 19" deep, 30" width, and 27" high			

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: BASEBALL RESTROOMS

	Yes	No	Comments
Cover exposed pipes with insulation			
Faucets operable with closed fist (level or spring activated handle)			NONCOMPLIANT HARDWARE AND OUT OF REACH
At least one stall:			
Accessible to person using wheelchair at 60" wide or 72" inches deep			
Stall door is 36" wide			N/A
Stall door swings out			N/A
Stall door is self closing			N/A
Stall door has a pull latch			N/A
Lock on stall door is operable with a closed fist, and 32" above the floor			
Coat hook is 54" high			NO HOOK
Toilet:			
18" from center to nearest side wall			
42" minimum clear space from center to farthest wall or fixture			
Top of seat 17"-19" above the floor			
Grab Bars			
On back and side wall closest to toilet			
1 1/4" diameter			
1 1/2" clearance to wall			
Located 30" above and parallel to the floor			
Acid-etched or roughened surface			
42" long			
Fixtures			
Toilet paper dispenser is 24" above floor			
One mirror set a maximum 38" to bottom (if tilted 42")			
Dispenser (towel, soap, etc) at least one of each a maximum 42" above the floor			

Floors, drinking fountains, telephones

Floors:			
Non-slip surface			SEALED CONCRETE
carpeting is high-density, low pile, non-absorbent stretched taut, securely anchored			N/A
Corridor width minimum is 3ft			N/A
Objects (signs, ceilings, fixtures) can only protrude 4" into the path of travel from a height of 27" to 80" above the floor			
Drinking fountains			
Spouts no higher than 36" from floor to outlet			N/A
Hand Operated push button or level controls			N/A
Spouts located near from with stream of water as parallel to front as possible			N/A
If recessed, recess a minimum 30" width, and no deeper than depth of fountain			N/A
If no clear knee space underneath, clear floor space 30" x 40" to allow parallel approach			N/A
Telephones			
Highest operating part a maximum 54" above the floor			N/A
Access within 12" of phone, 30" high by 30" width			N/A
Adjustable volume control on headset so identified			N/A
Signs, Signals, and Switches			
Switches, Controls, and Signs			

DISTRICT: 3

LOCATION: VERNON HILL PARK

BUILDING: BASEBALL RESTROOMS

	Yes	No	Comments
Switched and controls for light, heat, ventilation, windows, fire alarms, thermostats, etc, must be a minimum of 36" and a maximum of 48" above the floor for a forward reach, a maximum of 54" for a side reach			
Electrical outlets centered no lower than 18" above the floor			
Warnings signals must be visual as well as audible			NO SYSTEM
Signs, Signals, and Switches			
Mounting height must be 60" to centerline of the sign			NO SIGNAGE 2/3
Within 18" of door jamb or recessed			NO SIGNAGE 2/4
Letters and numbers at least 1 1/4" high			NO SIGNAGE 2/5
Letters and numbers raised .03"			NO SIGNAGE 2/6
Letters and numbers contrast with the background color			NO SIGNAGE 2/7

VERNON HILL PARK
Restroom / Concession Building

